

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_09_12(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 09. 12. 14:32:03

Chart:

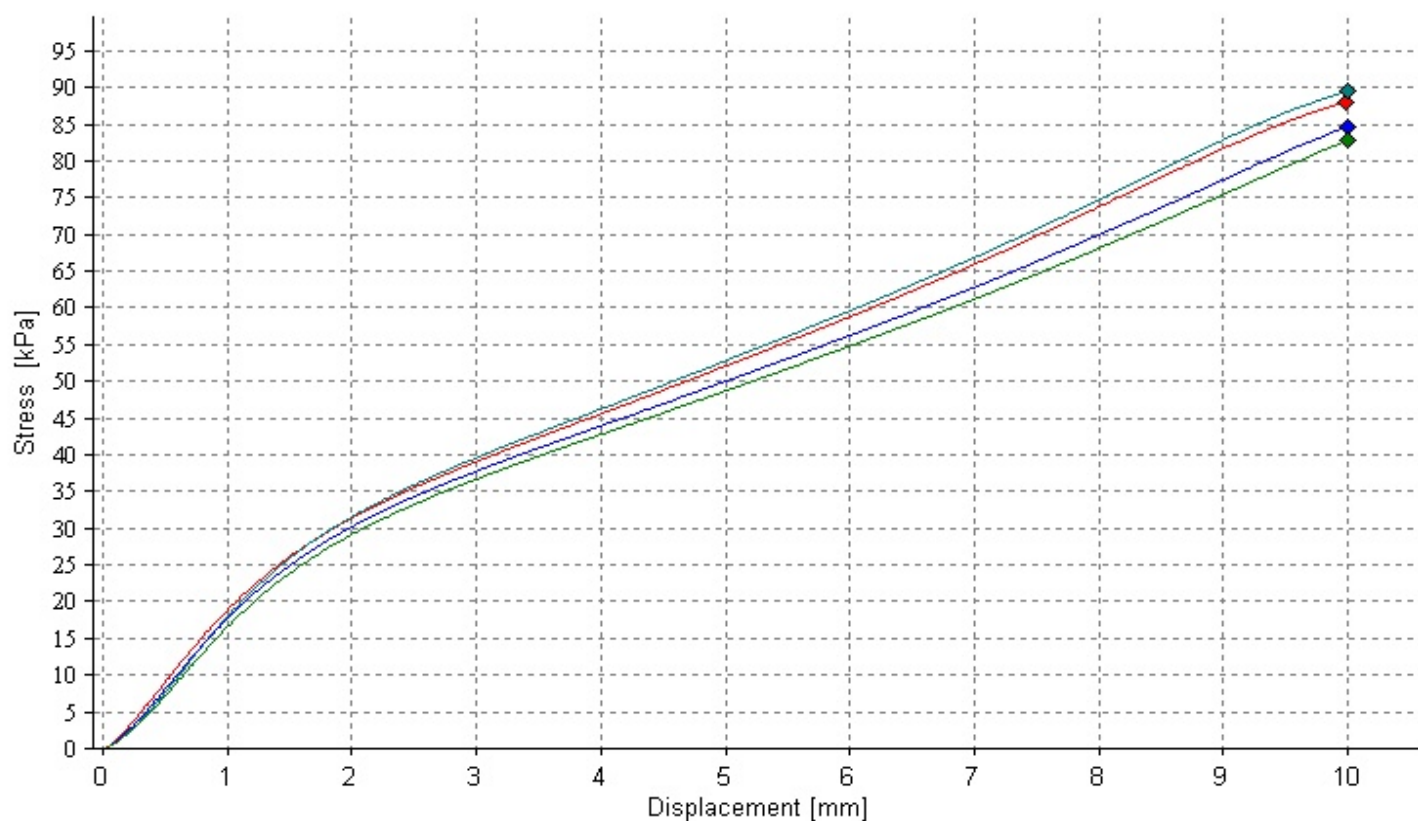

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_09_12 (1)	88,09	9,99
P80/2019_09_12 (3)	89,53	10,00
P80/2019_09_12 (4)	84,65	9,99
P80/2019_09_12 (5)	82,85	10,00
Max.	89,53	10,00
Min.	82,85	9,99
Mean	86,28	9,99