

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_10_09(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019.10.09. 14:50:16

Chart:

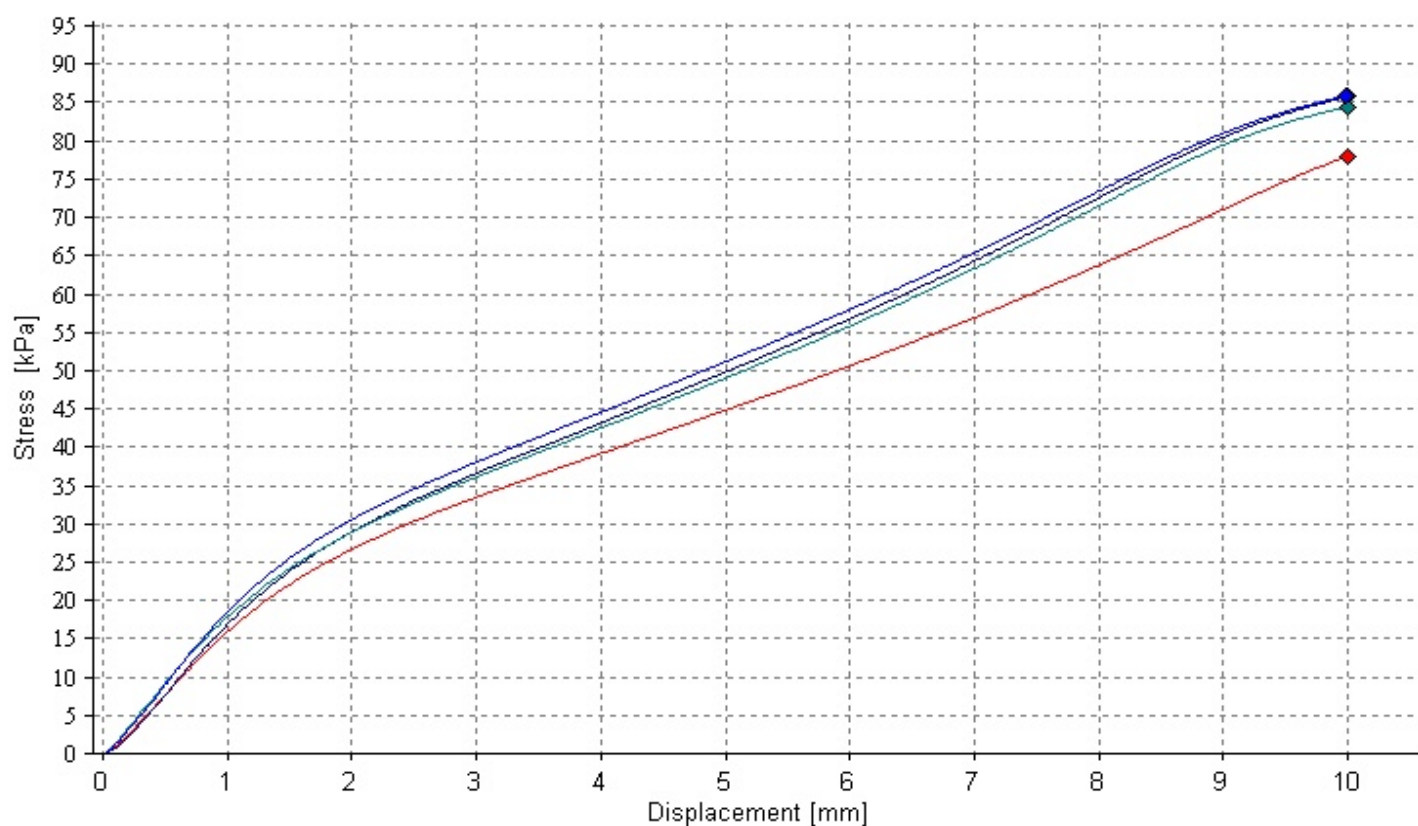

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_10_09 (1)	77,97	9,99
P80/2019_10_09 (2)	85,75	10,00
P80/2019_10_09 (3)	84,43	10,00
P80/2019_10_09 (4)	85,86	9,99
Max.	85,86	10,00
Min.	77,97	9,99
Mean	83,50	9,99