

Project:

Order No: Premio EPS100 Compression test

Part No: P100/2019_11_08(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 11. 08. 15:02:24

Chart:

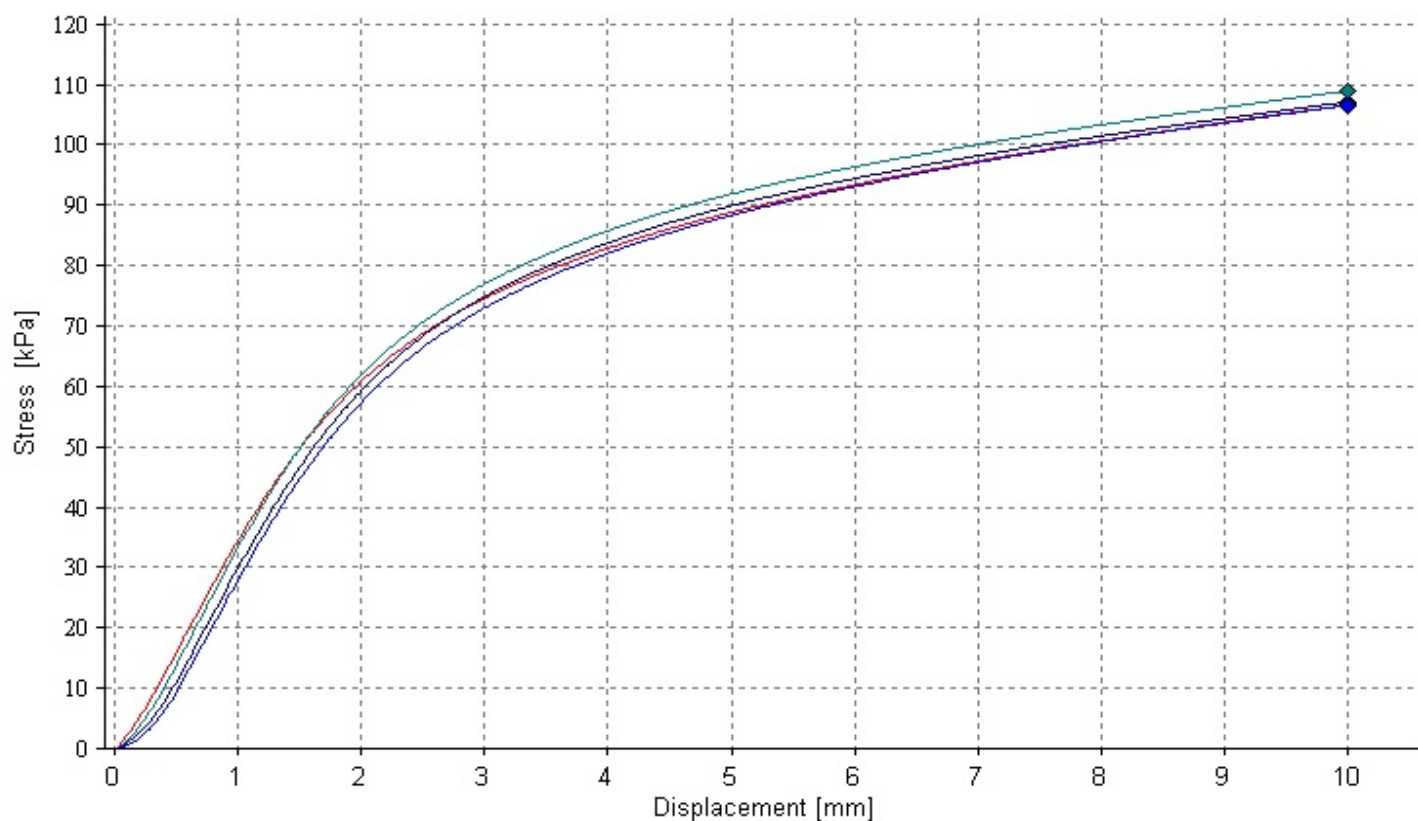

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P100/2019_11_08(1)	106,64	10,00
P100/2019_11_08(2)	107,12	9,99
P100/2019_11_08(3)	108,94	10,00
P100/2019_11_08(4)	106,55	9,99
Max.	108,94	10,00
Min.	106,55	9,99
Mean	107,31	9,99